



Rockwool supports FIRAS  
accredited installers



Cert. N°: 022d



## SP Firestop Systems

The purpose-made insulation slabs/strips for cavity fire stops

As part of the comprehensive Firepro range of fire protection products, Rockwool SP Firestop Slab is a product specifically designed to form cavity fire stops within buildings.

It may be installed horizontally or vertically and is suitable for cavity widths between 50mm and 400mm in both masonry and curtain wall constructions.

NB For cavity widths of 250mm or more, joints between adjacent lengths of firestops should be sealed on the top surface with aluminium foil tape.

The product has been designed as a one-piece system and affords easy cutting and installation. There is also a cut to size service which provides specific widths supplied in 48 hours and small quantities, if required. It provides a unique lateral compression to facilitate tightness of fit.

The product is available in two versions:

SP 60 Slab, giving 1 hour fire resistance.

SP 120 Slab, giving 2 hours fire resistance.



SP Firestop Slabs at floor / external wall junction  
International Patent App. PCT/GB98/01733

### Advantages

- Easy to cut and install
- Ensures site tolerances are accommodated
- Tested over 2 hours fire resistance
- Resists the passage of smoke – aluminium foil faced on both sides
- Available Cut to size from 48 hours
- Suitable for cavity widths up to 400mm
- Easy site storage and handling
- Quality assured to BS EN ISO 9001



The following NBS Plus clause includes SP 60 and SP 120 Firestop Slabs: h42:700

# 1 and 2 hour fire stopping

## Description

### Shape and dimensions

Rockwool SP 60 Firestop Slab: 900 × 650 × 75mm thick

Rockwool SP 120 Firestop Slab: 900 × 650 × 90mm thick

The products are faced on both sides with reinforced aluminium foil to give Class O rating and excellent smoke resistance.

Both slabs are designed to be cut on site to produce cavity fire stops of 900mm length and in widths to suit individual cavity sizes, as shown in Figure A.

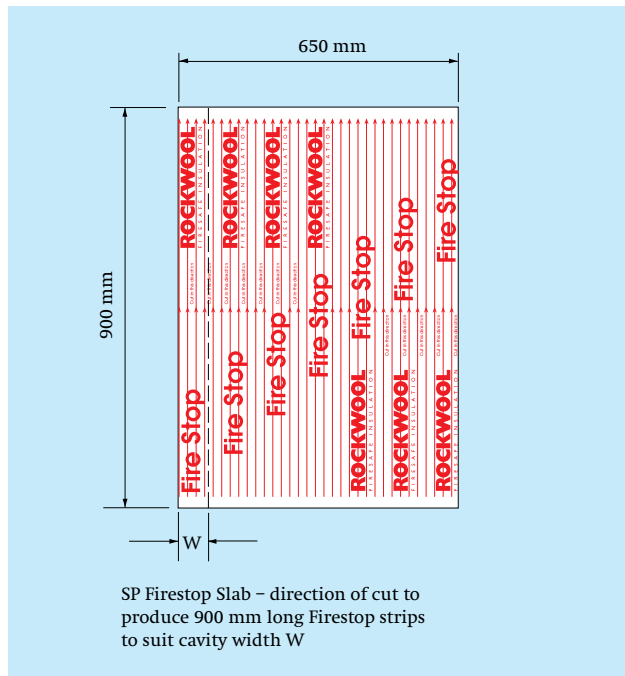


Figure A Cutting method for SP Firestop Slab

### Accessories

Rockwool SP Fixing Brackets\* are required for the installation (figure B). They are supplied in two standard types, namely SP/S Fixing Bracket designed for cavities up to and including 100mm wide and SP/L Fixing Bracket for cavities over 100mm and up to 400mm wide.

Brackets are supplied in cardboard boxes, flat packed, and are designed to be easily re-profiled by hand on site. The SP Fixing Brackets should be cut on site as necessary to allow at least 75% penetration of the Firestop.

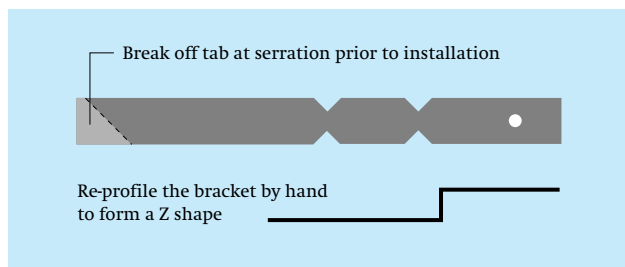


Figure B SP Firestop Fixing Bracket

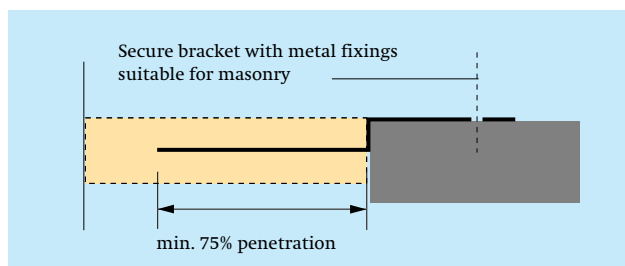


Figure C Sectional view of Firestop Slab and Bracket

## Standards and Approvals

Rockwool SP 60 and SP 120 Firestop Slabs have been tested and assessed in accordance with BS 476: Part 20: 1987 and have achieved 60 minutes and 120 minutes respectively for both integrity and insulation, as detailed in LPC assessment CC89697.

Rockwool SP 60 and SP 120 Firestop Slabs comply with the provisions of Approved Document B3 of the 1991 building Regulations (2002 edition).

## Environment

No CFCs, HFCs or HCFCs are used in the manufacture of Rockwool materials.

## Performance

### Fire

The base mineral wool of Rockwool SP 60 and SP 120 Firestop Slabs is inherently fire safe and achieves Euro Class A1. Rockwool products will withstand temperatures in excess of 1000°C without melting.

### Acoustic

Rockwool products have excellent acoustic properties and can appreciably reduce the levels of airborne sound transmission through wall and floor cavities.

### Resistance to moisture

Rockwool SP 60 and SP 120 Firestop Slabs are water repellent and unaffected by the freeze/thaw cycle.

## Applications

Fire resistance between the edge of a concrete floor slab and curtain walling which is stable in fire.

Rockwool SP 60 and SP 120 Firestop Slabs provide one and two hours fire resistance respectively in voids up to 400mm wide.

Note that curtain walling systems should be adequately restrained to the floor.

Figure D illustrates a typical arrangement, using SP Fixing Brackets at 450mm centres.

### Masonry wall cavities

Rockwool SP 60 and SP 120 Firestop Slabs provide one and two hours fire resistance respectively in masonry wall cavities up to 400mm wide. They can be used both horizontally and vertically.

Figure E illustrates typical applications, with the product fitted tightly between masonry leaves. When it is not possible to build the brackets into a leaf, the fixings can be re-profiled as necessary and mechanically fixed to the face of the masonry.

The application of Rockwool SP Firestop Slabs is the responsibility of the site operator. Fixing sequence instructions are shown clearly on each pack as well as cutting guide lines on the surface of each slab.

### External cladding

Where used in conjunction with profiled metal cladding, cut the Rockwool SP Firestop Slab to suit the profile.

\*Note In order to comply with the fire test certification, only Rockwool SP Fixing Brackets should be used to install the product.

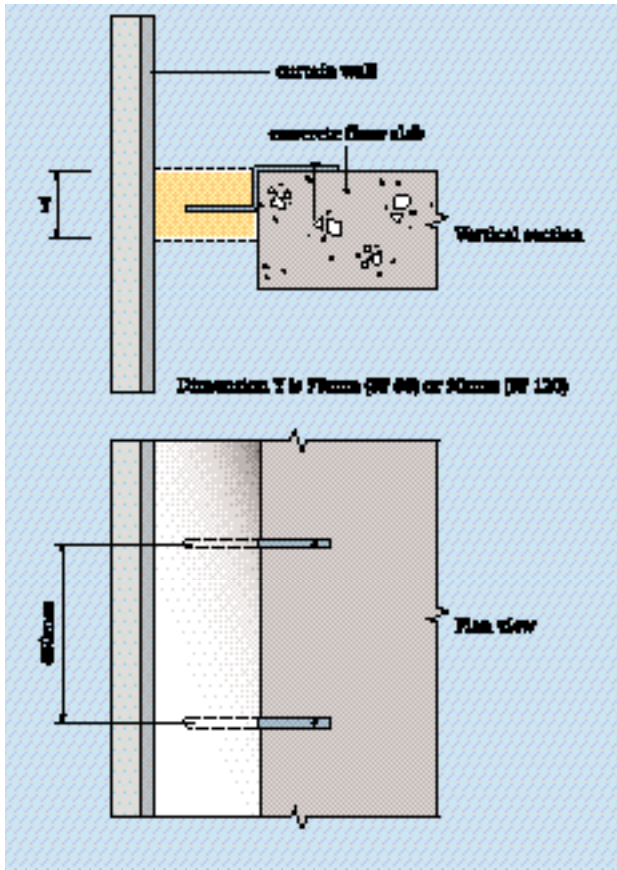


Figure D – Rockwool SP Firestop Slab between floor and curtain wall

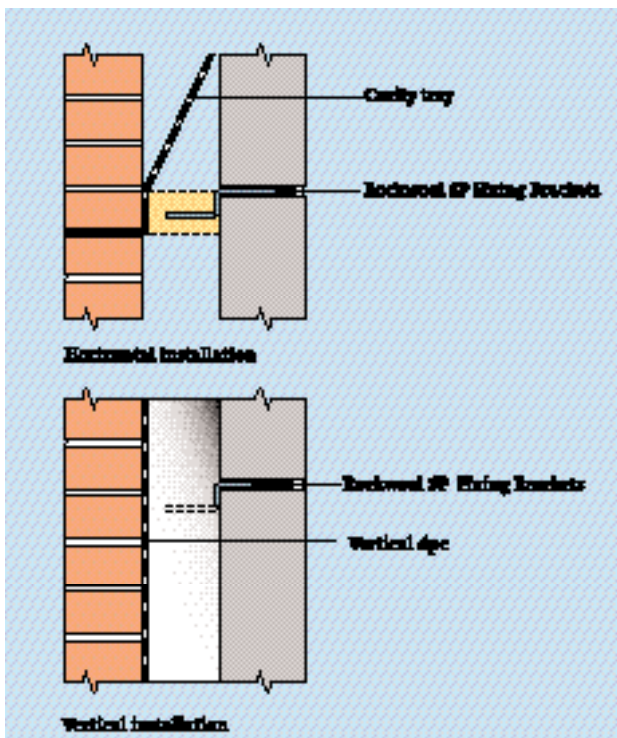


Figure E – Rockwool SP Firestop Slab between masonry leaves

Suitable for cavity widths up to 400mm\*

### Sitework

#### General

Rockwool SP Firestop Slabs are designed for cutting on site with a sharp knife or saw and a straight edge. The cavity to be firestopped should be measured and the Rockwool SP Firestop Slab cut to suit this dimension, using one piece only per gap width – see Figures C, D and E.

For easy compression fitting and to accommodate the fixing pattern, cutting should be along the 900mm width as indicated in figure A.

The SP Fixing Brackets are then re-profiled by hand and cut as necessary to allow at least 75% penetration of the fire stop material. They should be placed as shown in the diagrams, or fixed by other suitable mechanical means.

#### Curtain Walling

The fixing sequence is as follows:

- 1 Cut the Rockwool SP Firestop Slab allowing an additional 3–5mm for compression when fitted.
- 2 The Rockwool SP 60 or SP 120 Firestop Slab is impaled onto the SP Fixing Brackets at the rate of 2 per 900mm length, fixed at 450mm  $\pm$ 10mm centres, as shown in Figure D. The SP Fixing Brackets should be placed 225mm  $\pm$  10mm in from each end of the Rockwool SP Firestop Slab.
- 3 The product should then be fitted securely into the void, and tightly butted to the adjacent Rockwool SP Firestop Slab.
- 4 Once the Rockwool SP Firestop Slab has been accurately fitted, the SP Fixing Brackets must then be mechanically fixed to the edge of the floor slab with metal fixings suitable for masonry.

#### Masonry wall cavities

The fixing sequence is as follows:

- 1 Cut the Rockwool SP Firestop Slab to suit the cavity size, ensuring a tight fit.
- 2 After suitably re-profiling the SP Fixing Brackets, they can be built into the bed joints of the internal leaf at 450mm  $\pm$ 10mm centres. Alternatively, the SP Fixing Brackets may be re-profiled by hand into an 'L' shape and mechanically fixed to the face of the inner leaf.
- 3 The Rockwool SP Firestop Slab is then impaled onto the SP Fixing Bracket after the next lift of inner leaf masonry.
- 4 Work on both leaves can then be continued and must include either a vertical damp proof course or a cavity tray, installed over the Rockwool SP Firestop Slab as shown in Figure E.

\*NB For cavity widths of 250mm or more, joints between adjacent lengths of firestops should be sealed on the top surface with aluminium foil tape.

## Site Use

### Storage and handling

Rockwool SP Firestop Slabs are light and easy to handle. They are supplied compression wrapped in polyethylene, which will provide short term protection. For long term storage they must be protected by a waterproof covering.

### Estimating quantities

The chart below indicates the usage of Rockwool SP Firestop Slabs and fixings, assuming accurate site cutting practices.

Slab size: 900 × 650mm

Cavity width (mm)	No of 900mm strips per slab	Linear metres per slab (m)	Linear metres per pack (m)	No of fixings required per pack
50	12	10.8	43.2	96
55	11	9.9	39.6	88
60	10	9.0	36.0	80
65	9	8.1	32.4	72
70	8	7.2	28.8	64
75	8	7.2	28.8	64
80	7	6.3	25.2	56
85	7	6.3	25.2	56
90	6	5.4	21.6	48
95	6	5.4	21.6	48
100	6	5.4	21.6	48
110	5	4.5	18.0	40
120	5	4.5	18.0	40
130	4	3.6	14.4	32
140	4	3.6	14.4	32
150	4	3.6	14.4	32
160	4	3.6	14.4	32
170	3	2.7	10.8	24
180	3	2.7	10.8	24
190	3	2.7	10.8	24
200	3	2.7	10.8	24
210	3	2.7	10.8	24
220	2	1.8	7.2	16
230	2	1.8	7.2	16
240	2	1.8	7.2	16
250	2	1.8	7.2	16
260	2	1.8	7.2	16
270	2	1.8	7.2	16
280	2	1.8	7.2	16
290	2	1.8	7.2	16
300	2	1.8	7.2	16

## Typical specifications

### Curtain Walling

The cavity fire stop between the edge of the concrete floor slab and curtain walling is to be Rockwool SP 60 or SP 120 Firestop Slab as manufactured by Rockwool Limited, Pencoed, Bridgend CF35 6NY to provide 1 hour or 2 hour fire resistance for both integrity and insulation criteria (LPC assessment CC89697). Fixings are to be Rockwool SP/S or SP/L Fixing Brackets, fixed in accordance with the details given in the this data sheet.

Slabs should be cut to suit the width of the as-built cavity, allowing an additional 3–5mm for compression, and securely fitted into the void. All joints are to be tightly butted. (Please see \*Curtain Walling and External Cladding Systems, below).

### Masonry wall cavity

The cavity barrier is to be Rockwool SP 60 or SP 120 Firestop Slab as manufactured by Rockwool Limited, Pencoed, Bridgend CF35 6NY to provide 1 hour or 2 hour fire resistance for both integrity and insulation criteria (LPC assessment CC89697).

Fixings are to be Rockwool SP/S or SP/L Fixing Brackets, fixed in accordance with the details given in this data sheet.

A damp proof membrane or cavity tray is to be installed during the construction of the outer leaf. Slabs should be cut to suit the width of the as-built cavity and securely fitted. All joints are to be tightly butted.

### \*Curtain walling and external cladding systems

Rockwool SP FireStop Slabs will provide fire stopping in conjunction with a stable, external façade system. If, during a fire, the behaviour of the facade panel or its fixing is such that a gap develops between the Rockwool SP FireStop Slab and the panel allowing fire to pass through, Rockwool Limited cannot accept liability for failure. Specifiers should ensure that the choice of the curtain walling components will not diminish fire-stopping requirements.

Curtain walling systems are manufactured from a wide range of materials which react differently in fire. Large scale independent UK investigations have shown that some glazed or aluminium external cladding systems are liable to integrity failure under fire attack within short periods of time – 5 and 20 minutes respectively.

Steel faced composite panels filled with combustible insulation can be unstable under fire attack. Curtain walling systems incorporating fire-sensitive panels may suffer severe movement and buckling, resulting in gaps forming between the panel and the Rockwool SP FireStop Slab.

## Health and safety

All Rockwool products are subject to a Maximum Exposure Limit as follows: 5 mg/m<sup>3</sup> total dust per 8 hours (Time Weighted Average).

A Material Safety Data Sheet is available from the Rockwool Marketing Services Department.

A COSHH Data sheet is available from Rockwool's Marketing Services Department.

Current HSE 'CHIP' Regulations and EU Directive 97/69/EC confirm that Rockwool fibres are not classified as a possible carcinogen.

## Supply

Available throughout the United Kingdom from Rockwool stockists. A list of stockists is available on request.

### Ordering

There are 4 slabs per standard pack. For stockists requiring the cut pieces and 48 hour delivery, please order on Fax number 01656 865649 to ensure fast response.

Please quote Rockwool SP 60 or SP 120 Firestop Slab and the number of packs and brackets required. The chart opposite may assist estimators.

## Technical services

For technical advice relating to SP Firestop and all other fire protection solutions in the Rockwool Firepro range, call the Rockwool Technical Helpline on 0871 222 1780.

**ROCKWOOL**  
F I R E S A F E I N S U L A T I O N

Rockwool Limited Pencoed, Bridgend, CF35 6NY  
Email: info@rockwool.co.uk Web: www.rockwool-firepro.com

Rockwool Limited reserves the right to alter or amend the specification of products without notice as our policy is one of constant improvement.

The information contained in this data sheet is believed to be correct at the date of publication. Whilst Rockwool will endeavour to keep its publications up to date, readers will appreciate that between publications there may be pertinent changes in the law, or other developments affecting the accuracy of the information contained in this data sheet.

The above applications do not necessarily represent an exhaustive list of applications for SP 60 and SP 120 Firestop Slabs. Rockwool Limited does not accept responsibility for the consequences of using SP 60 and SP 120 Firestop Slabs in applications different from those described above. Expert advice should be sought where such different applications are contemplated, or where the extent of any listed application is in doubt.